




Report: Mesures de vibrations

Project: JOINVILLE

From: 08/01/2017 00:00:00
To: 09/01/2017 23:59:59
Values from: 08/01/2017 00:15:00
Values up to: 09/01/2017 17:00:00


MP_1 X Bâtiment de la galerie centrale C12X, S/N: 60371, Calibrated: 05/01/2016

ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

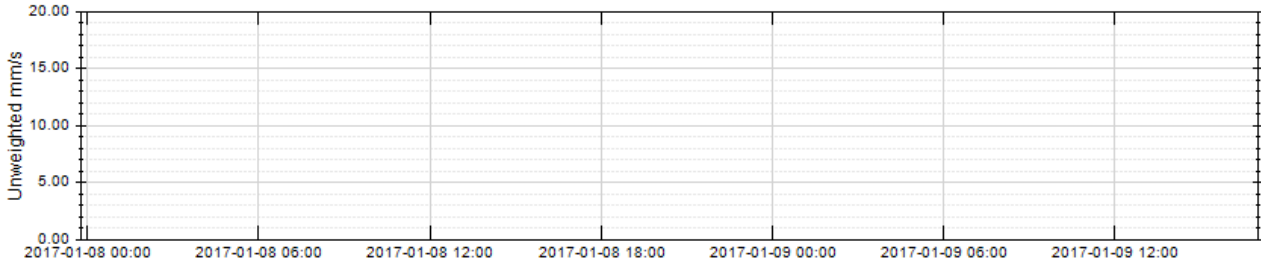


MP_1 Y Bâtiment de la galerie centrale C12Y, S/N: 60372, Calibrated: 05/01/2016

ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

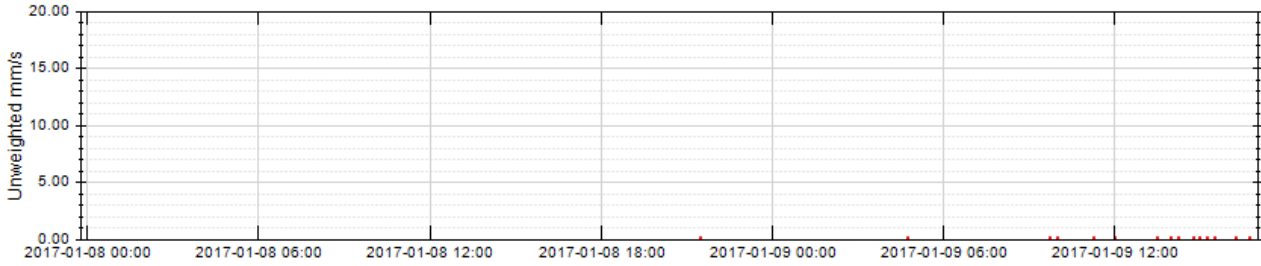

MP_1 Z Bâtiment de la galerie centrale C12Z, S/N: 60370, Calibrated: 05/01/2016


ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

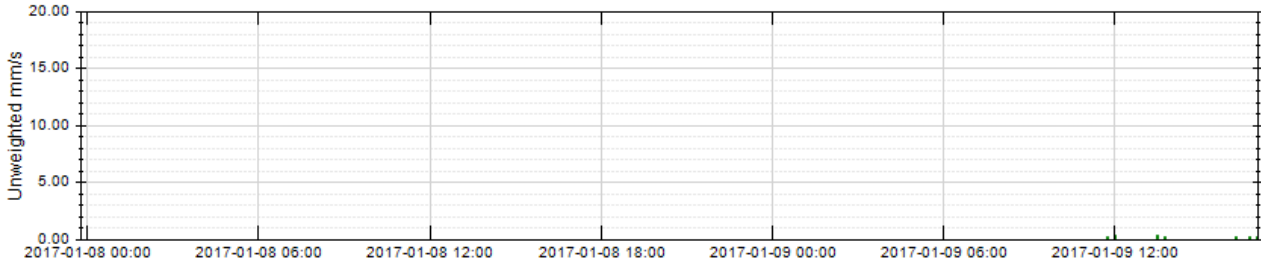

	C12X	C12Y	C12Z
Unw Max:	0.10 mm/s	0.26 mm/s	0.28 mm/s
Frequency:	7,0 Hz	14.5 Hz	7,0 Hz
Date:	09/01/2017	09/01/2017	09/01/2017
Time:	15:00:00	14:15:00	13:30:00
Customer:			
Notes:			

Unw = Unweighted

ICPE-Circ86+Freq

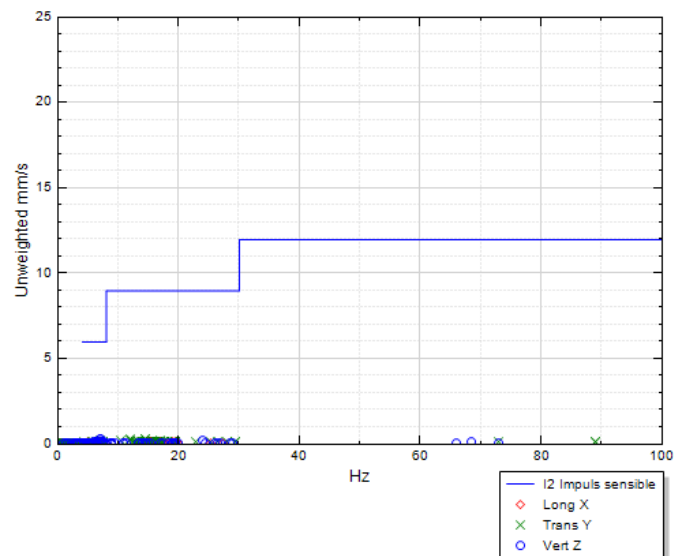




Report: Mesures de vibrations


Project: JOINVILLE

From: 08/01/2017 00:00:00
To: 09/01/2017 23:59:59
Values from: 08/01/2017 00:05:00
Values up to: 09/01/2017 17:00:00


MP_2 X Bâtiment des préfiltres C12X, S/N: 61381, Calibrated: 09/06/2016 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

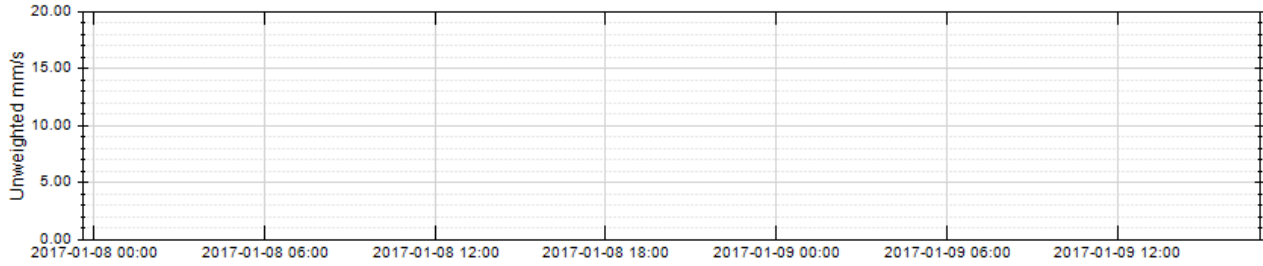

MP_2 Y Bâtiment des préfiltres C12Y, S/N: 61382, Calibrated: 09/06/2016 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

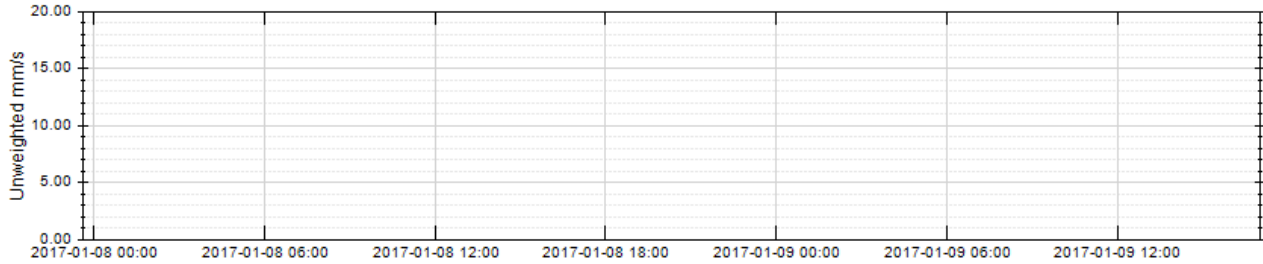


MP_2 Z Bâtiment des préfiltres C12Z, S/N: 61380, Calibrated: 09/06/2016 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I2

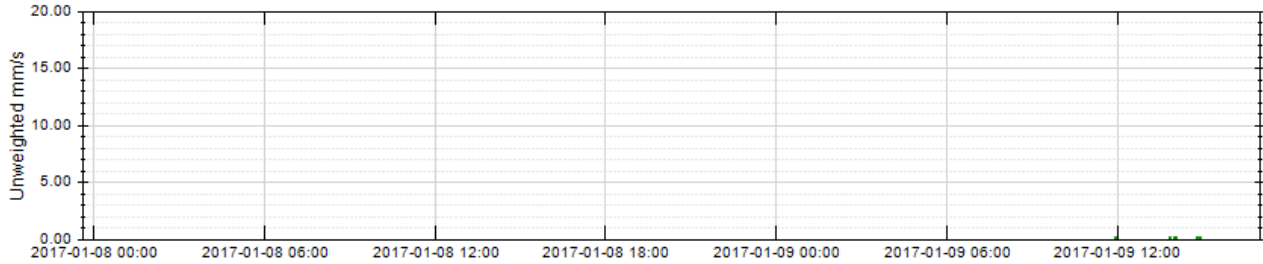

	C12X	C12Y	C12Z
Unw Max:	0.05 mm/s	0.08 mm/s	0.18 mm/s
Frequency:	11.5 Hz	8,0 Hz	7.5 Hz
Date:	09/01/2017	09/01/2017	09/01/2017
Time:	13:30:00	08:55:00	14:05:00
Customer:			
Notes:			

Unw = Unweighted

ICPE-Circ86+Freq

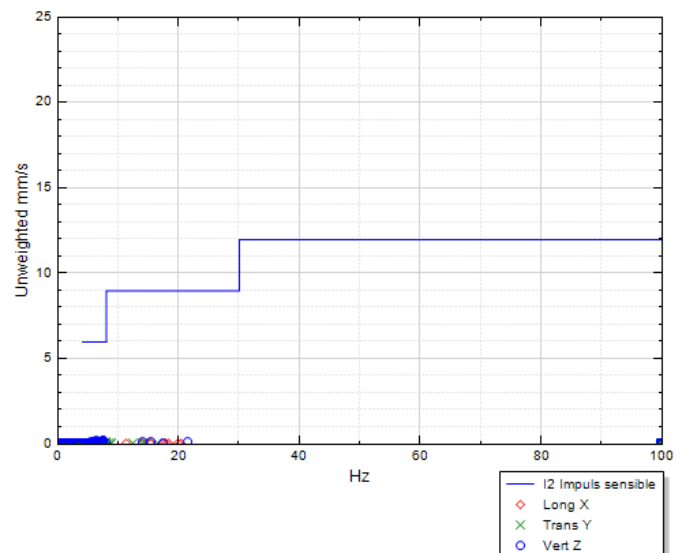




Report: Mesures de vibrations


Project: JOINVILLE

From: 08/01/2017 00:00:00
To: 09/01/2017 23:59:59
Values from: 08/01/2017 00:05:00
Values up to: 09/01/2017 17:00:00


MP_3 X galerie d eau préfiltrée C12X, S/N: 64051, Calibrated: 04/11/2015 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I3

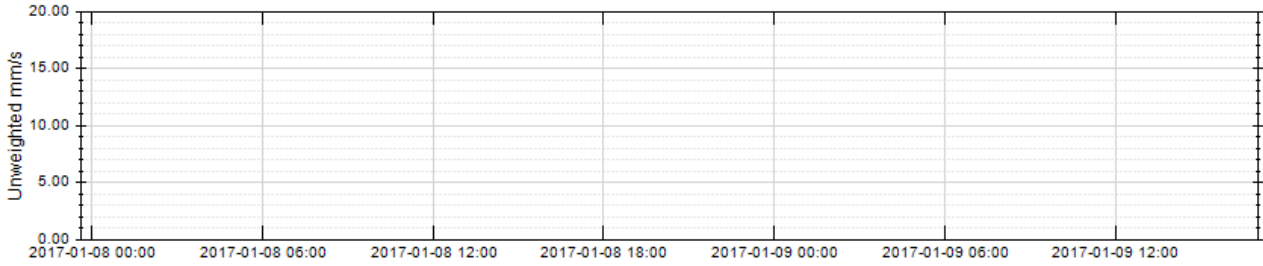

MP_3 Y galerie d eau préfiltrée C12Y, S/N: 64052, Calibrated: 04/11/2015 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I3

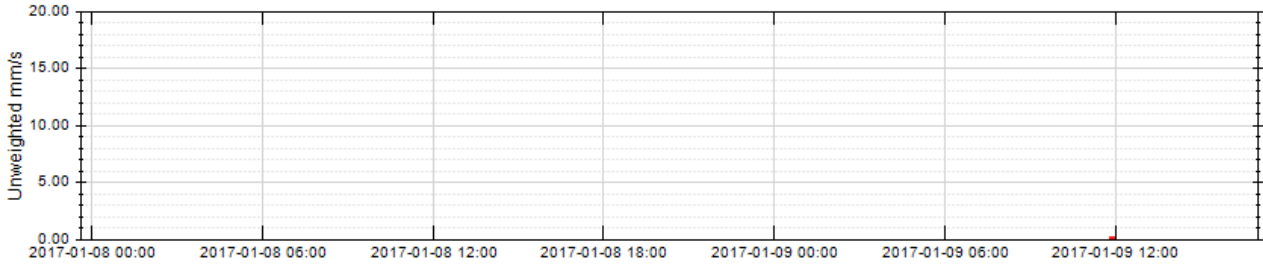

MP_3 Z galerie d eau préfiltrée C12Z, S/N: 64050, Calibrated: 04/11/2015 ICPE-Circ86+Freq 25 mm/s 1-150Hz, I3

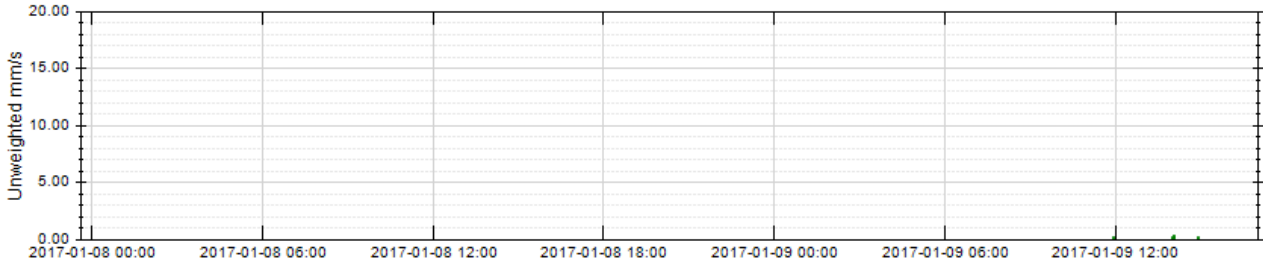

	C12X	C12Y	C12Z
Unw Max:	0.08 mm/s	0.15 mm/s	0.29 mm/s
Frequency:	171,0 Hz	21.5 Hz	8,0 Hz
Date:	09/01/2017	09/01/2017	09/01/2017
Time:	10:05:00	11:50:00	14:05:00
Customer:			
Notes:			

Unw = Unweighted

ICPE-Circ86+Freq

